


SIGNAL IDENTIF.

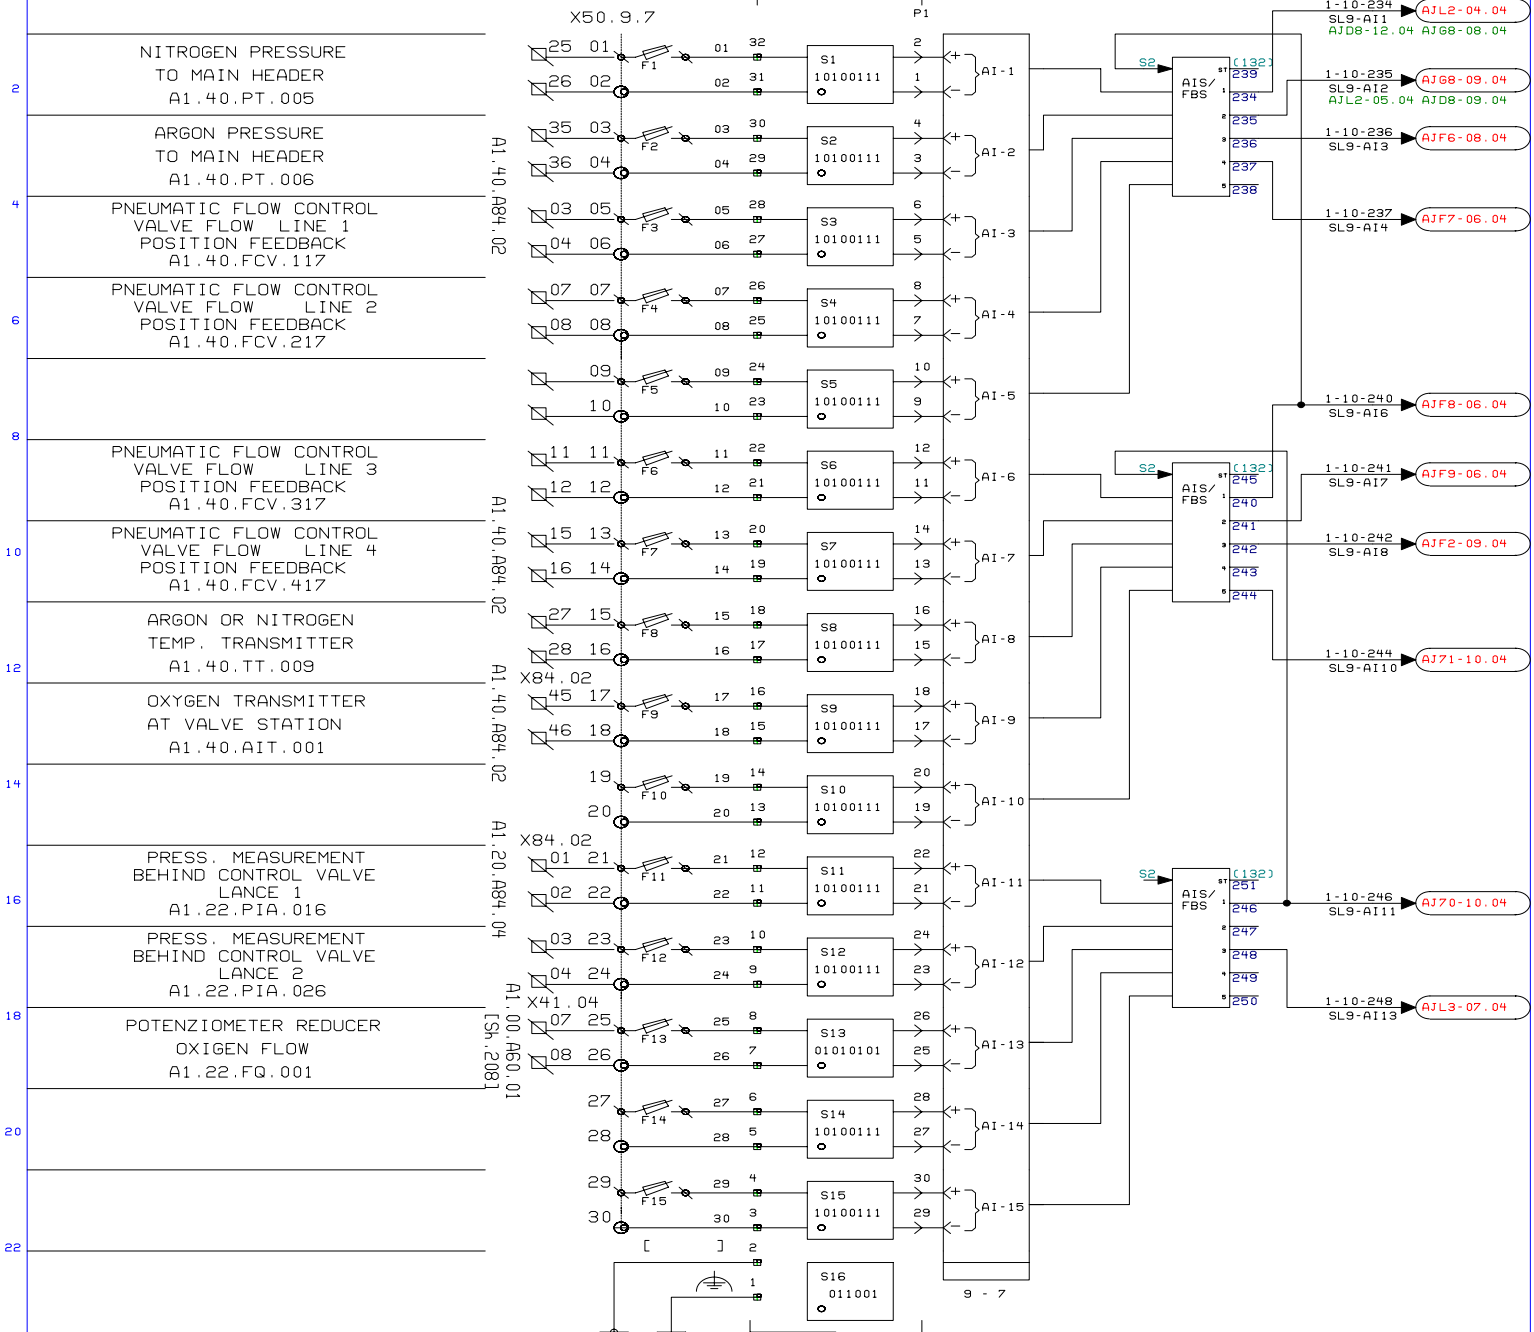

NOTES:

- -24VDC
- -125VDC
- ▽ ISOLATED SYSTEM COMMON BUS

PCU 1 MFC LOC: 1 - 8 - 8  
 MADR 10  
 SLADR 9

NASI02 WITH NIA104 & TERMINAL BOARD

LOOP 1  
 PCU 1  
 MADR 10

AJ SHEET 08

DATE 09-29-2006

ORIGINAL ISSUE  
 DWN AGL  
 Bailey Controls Company

DURGAPUR STEELPLANT  
 DURGAPUR INDIA  
 C.A.R. SYSTEMS LTD.

LANCE 02 - BOTTOM STIR - 02 LC  
 CUSTOMER: DURGAPUR STEEL  
 PLANT: DURGAPUR, INDIA  
 CONTRACTING FIRM: C.A.R. SYSTEMS LTD.  
 B.C.CO. JOB NO.: CUST. ORDER NO.:

01-10-09.0

ANALOG INPUT SLAVE: #9

| REV | DATE | CHANGE | ENSRAPY | REV | DATE | CHANGE | ENSRAPY |
|-----|------|--------|---------|-----|------|--------|---------|
|     |      |        |         |     |      |        |         |
|     |      |        |         |     |      |        |         |
|     |      |        |         |     |      |        |         |
|     |      |        |         |     |      |        |         |

THIS DRAWING IS THE PROPERTY OF  
 BAILEY CONTROLS COMPANY. WITHOUT  
 THE WRITTEN PERMISSION OF  
 BAILEY CONTROLS COMPANY, NO  
 USE IS TO BE MADE OF IT WHICH IS  
 NOT BE LIMITED TO BAILEY  
 CONTROLS COMPANY.